


Missouri Department of Natural Resources

# 2008 Annual Compliance Report

of Missouri Public Drinking Water Systems

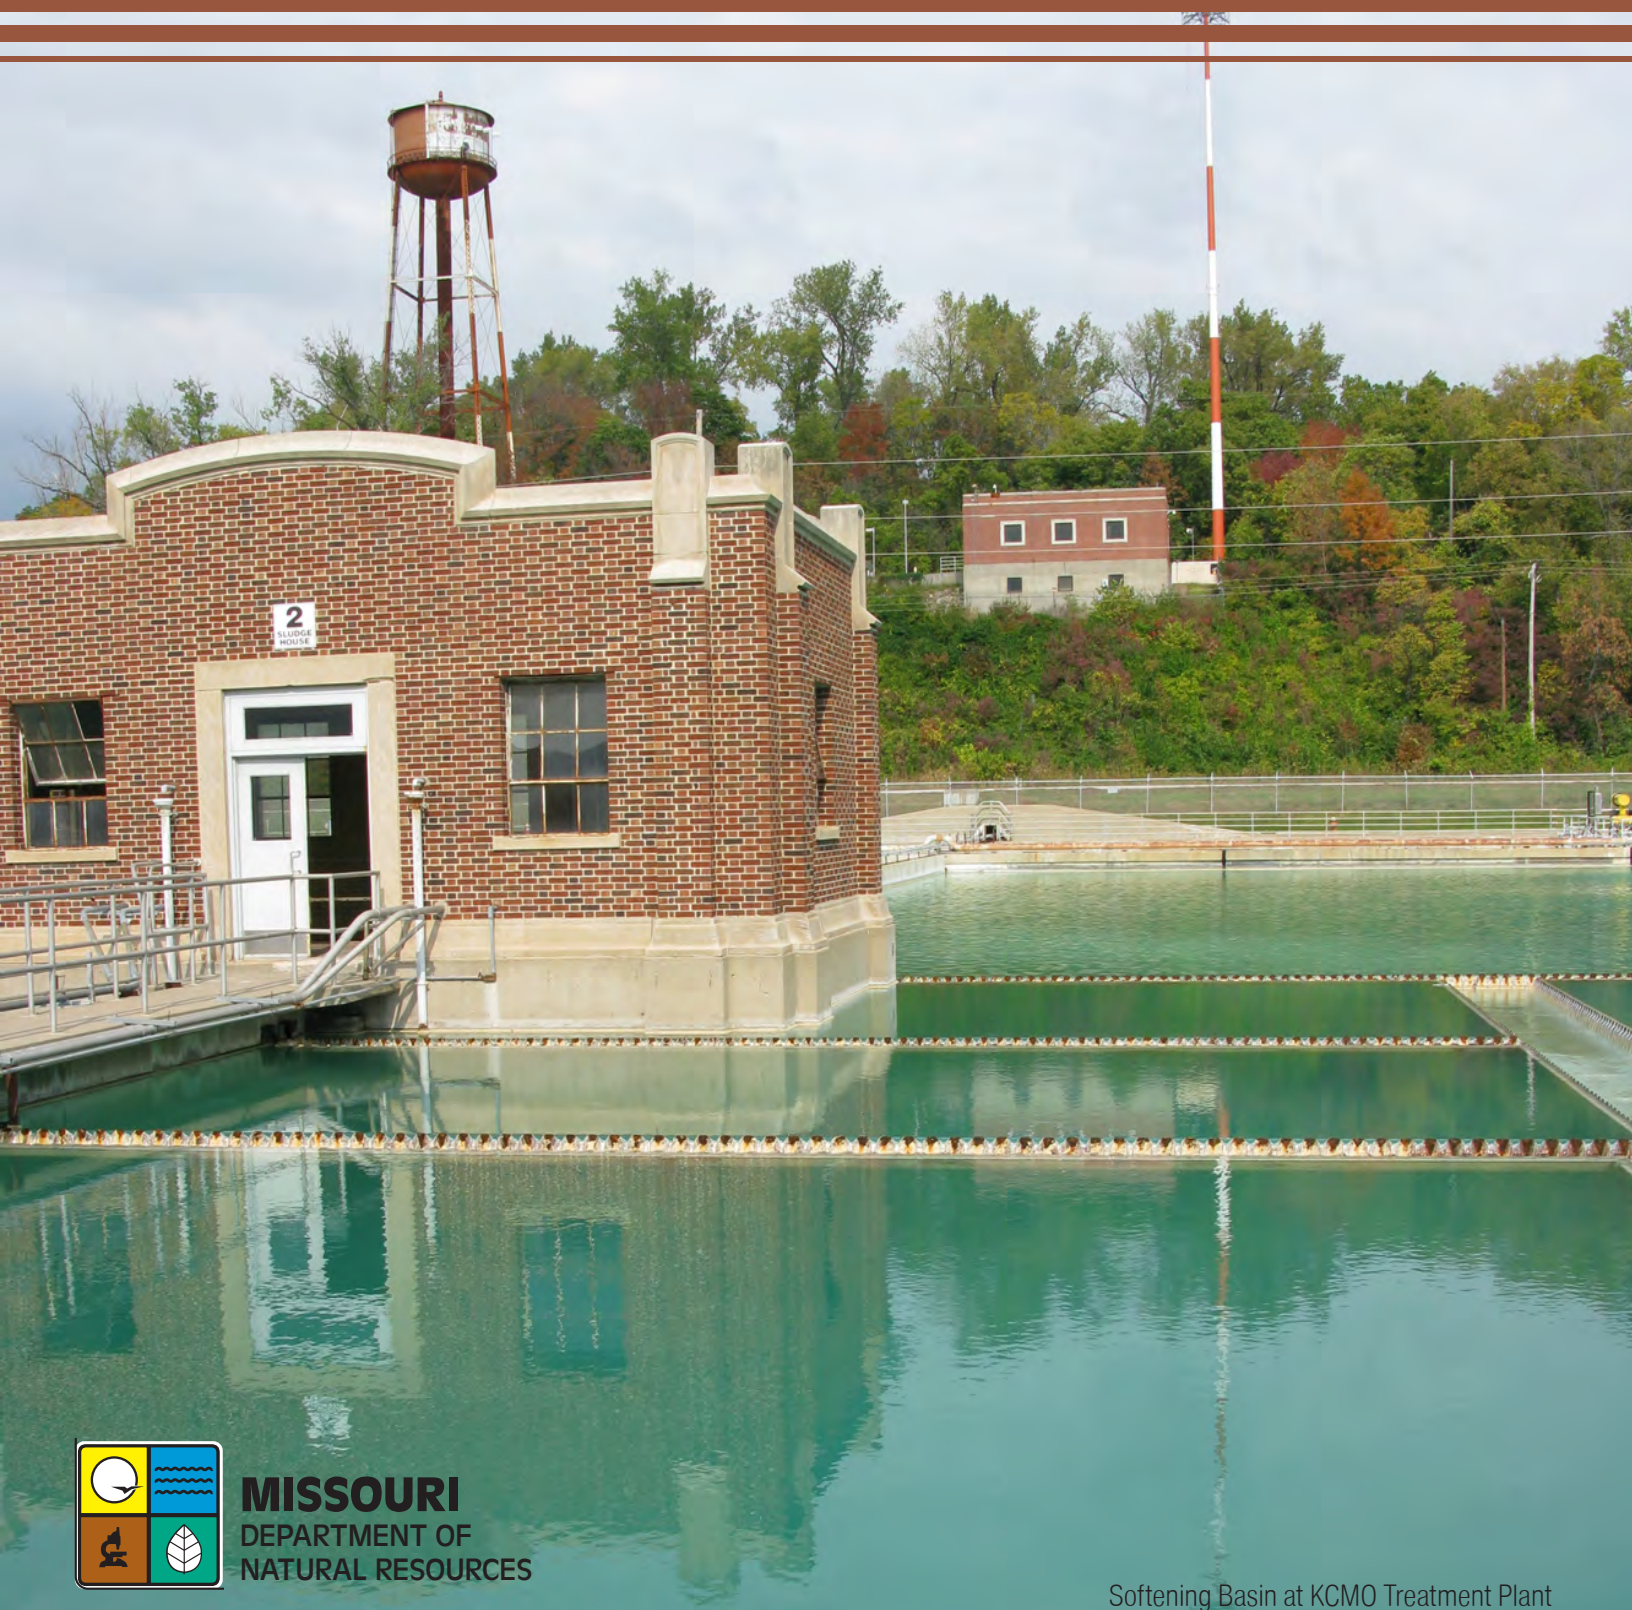

**MISSOURI**  
DEPARTMENT OF  
NATURAL RESOURCES

Softening Basin at KCMO Treatment Plant



# Table of Contents

Note from the Branch Chief . . . . .	2
Missouri Public Water System Universe . . . . .	3
Analysis of Compliance by Water Systems in 2008. . . . .	3
Compliance Activities . . . . .	5
Summary of Violations Table. . . . .	6
Organic Contaminants . . . . .	8
Inorganic Contaminants. . . . .	10
Radiologicals . . . . .	10
Microbiologicals. . . . .	10
Surface Water Treatment Rule . . . . .	11
Lead and Copper Rule . . . . .	11
Public Notification . . . . .	11
Appendix A: Listing of Acute Maximum Contaminant Level Violators . . . . .	12
I. Coliform . . . . .	
A. 2008 Boil Water Orders. . . . .	13
B. Non-Acute MCL Violations. . . . .	14
II. Chemical MCL Violations . . . . .	24
III. Radiological MCL. . . . .	25
IV. Surface Waters . . . . .	26
Appendix B: Listing of Chronic Major Monitoring Violators . . . . .	27
Appendix C: Listing of Major Repeat Monitoring Violators . . . . .	28
Appendix D: Listing of Significant Non-Compliers . . . . .	29

Cover photo: The Kansas City, Missouri Treatment Plant was constructed in 1925. Today it has a capacity to produce 240 million gallons of water per day.



## Note from the Branch Chief

The Public Drinking Water Branch of the Missouri Department of Natural Resources has the important mission of ensuring public water systems provide safe drinking water to every visitor and resident of Missouri. To do this, the branch sets limits and monitors for 91 contaminants that could be found in public drinking water supplies. This report provides information on how well public water systems in Missouri are meeting the standards for providing safe drinking water.

This is the twelfth Annual Compliance Report the Public Drinking Water Branch has produced since 1996 and covers compliance statistics for calendar year 2008. Each state produces a similar annual report on its public water systems. The reports are made available to the public and are provided to the U.S. Environmental Protection Agency for inclusion in a national report summarizing the performance of the nation's public drinking water systems.

The branch provides this report not only to comply with statutory obligations mandated by the federal Safe Drinking Water Act, but also to focus attention and provide an understanding of the importance of quality drinking water.

The report shows that Missouri's water systems continued to provide safe and reliable drinking water in 2008. Compliance with the monitoring and maximum contaminant level requirements of the Total Coliform Rule continue to be challenging. Also, some systems are experiencing difficulties complying with more stringent disinfection byproduct requirements. On a more positive note, many chronic violators of the radionuclide rule recently have, or soon will, attain compliance with this difficult and expensive rule. Additionally, compliance with the Consumer Confidence Reporting Rule has increased dramatically over the past few years, largely through stepped up outreach by the Department. We continue focusing on these and other standards to ensure Missourians will continue to receive high-quality, safe drinking water.

In late 2009 the new federal Groundwater Rule will go into effect, imposing a host of new requirements on the 92 percent of Missouri Public Water Systems that use groundwater as their source. This rule will provide major challenges in coming years. The Department has been working hard to assist the affected public water systems in preparing for this complicated rule.

I hope you find this report informative and useful.

A handwritten signature in black ink, appearing to read 'Sturgess', with a stylized flourish at the end. The signature is written on a light-colored, slightly textured background.

Steven W. Sturgess, Chief  
Public Drinking Water Branch  
Missouri Department of Natural Resources



## What is a Public Water System?

A Public Water System is defined as a system that provides water through piping or other constructed conveyances for human consumption to at least 15 service connections or serves an average of at least 25 people for at least 60 days each year. These are the systems that are the focus of this report.


There are three types of Public Water Systems:

- **Community systems** include towns, water districts, subdivisions, mobile home parks and residential facilities such as nursing homes or prisons.
- **Nontransient non-community systems** serve the same people every day, but not in a residential setting; schools and factories are good examples.
- **Transient non-community systems** serve different people daily, such as restaurants, resorts and rest stops. These smaller systems are typically in rural areas where it is not feasible to hook up to a city or water district.


Requirements for construction, operation, monitoring, etc., vary among systems based on their type, size and source of water.

Water testing at systems that are not Public Water Systems (for example, homes served by private wells) is facilitated by local and county sanitarians and the Missouri Department of Health and Senior Services, rather than the Department of Natural Resources.

## The Missouri Public 2008 Public Water Systems by Type

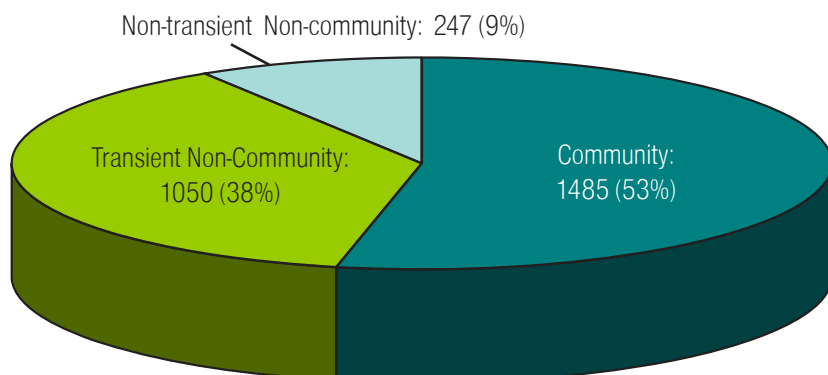

## Source of Water (Percent Population Served)

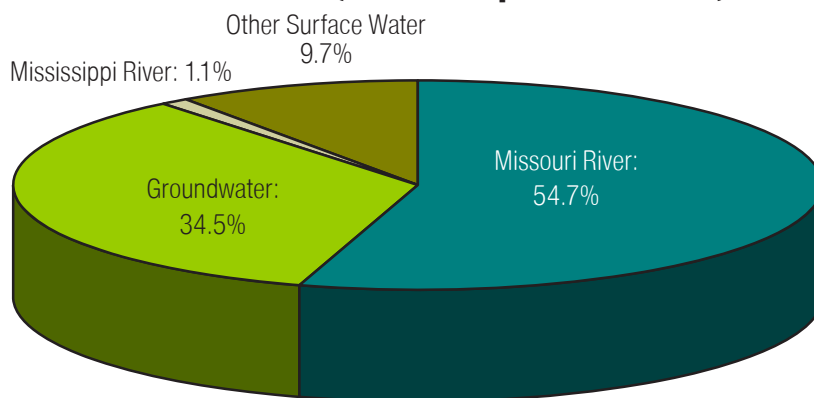

Note: In the past, didn't include alluvials for Missouri River

## Water System Universe

In 2008, there were 2,782 active PWSs in Missouri. Of this total, 1,485 were community, 247 were non-transient non-community and 1,050 were transient non-community systems.

The community water systems in Missouri served more than 5 million citizens in 2008. These citizens benefit from one of Missouri's most outstanding resources: its water. There is generally a large quantity of high-quality water in Missouri.

By far the largest source of drinking water for Missourians is surface water from the Missouri River. The abundant supply of water in the Missouri River and its proximity to the state's major population centers make the use of this river as a source so popular.

Groundwater is the next most used source of drinking water for Missouri's community supplies. In southern Missouri good quality groundwater is easy to obtain and typically


requires very little treatment to be used for drinking water. Some groundwater systems have the best of both worlds and use alluvial wells in valleys of the Missouri and Mississippi river system where they can get large volumes of water free of surface contaminants. Wells in the Missouri River alluvium provide groundwater to a significant population. More than half the state's population get their drinking water from the Missouri River or its alluvial wells. The importance of this resource cannot be overstated.

## Analysis of Compliance


We expect a lot from our public water systems and require testing for 91 different regulated chemicals and microbiological contaminants on a regular schedule. A system is to be applauded for performing all required testing and meeting all maximum contaminant levels, also referred to as MCL, and treatment technique standards. When violations do occur, that often is the first identification of a problem and can be the first step toward correcting it. Many public water systems perform testing beyond what is required by the state.

The Summary of Violations table in this report counts individual violations. Each PWS has the potential to accumulate multiple violations during the year because there are multiple regulations involved and some monitoring is on a monthly schedule. For example, the monitoring requirements for the Total Coliform Rule alone create a potential for more than 30,000 violations.

## Significant Non-Compliers

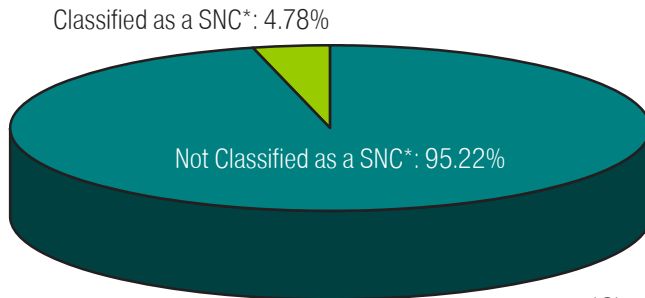

## Percent of Population Served by Significant Non-Compliers

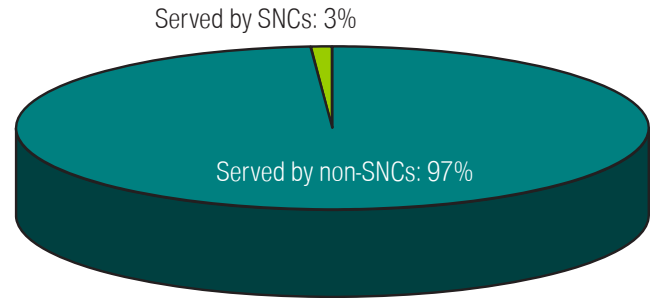

\*Significant Non-Complier

This puts some perspective on the violation figures shown in the Summary of Violations table and the information in the appendices. Another factor to consider is the number of systems that have violations. Many of the violations are from water systems with problems that result in multiple violations during the year. Other systems may only have one or two violations.

Appendices A through D list specific systems by county. The department uses various methods to focus on the water systems that need attention. One of these is the Significant Noncomplier, or SNC, List. This is a list of systems with serious violations that potentially affect public health or with multiple monitoring violations. Appendix D gives the list of Significant Non-Compliers for 2008. Some of the systems listed, however, may

have already resolved their problems. During 2008 there were 133 systems on the SNC list. Those systems listed as Significant Non-Compliers typically serve a small population. They accounted for 4.78 percent of public water systems, but only 3 percent of the population served. Maximum contaminant level and treatment technique violations represent the most significant impact on the public health. These occurred at a small number of public water systems serving approximately 10 percent of the population.


Since 1996, when the first Annual Compliance Report was produced, through 2003, Missouri has consistently met or exceeded EPA's target of serving water that meets all health-based standards to 95 percent of the population. Again in 2006, Missouri community water systems met EPA's target. The small dip below the

95 percent target in 2004 and 2005 did not represent a reduction in water quality, but is a result of more stringent drinking water standards. In 2007, this compliance measure dropped significantly.

In 2007 one of Missouri's largest public water systems experienced a treatment technique violation. The water system, Missouri American - St. Louis Division, serves St. Louis County. They have four separate treatment plants on the Missouri River and the Meramec River, serving a total of 1,049,600 customers. The violation they incurred was for exceeding combined filter effluent turbidity on one set of filters in one of their four surface water plants. Although the event only lasted 14 minutes and the water produced only reached 2 percent of their customers, EPA requires counting the entire population served by the entire system (all four plants) in calculating this benchmark. Had the actual population affected been used in the calculation, the statistic would have been 90.6 percent.

EPA and the states have worked together to develop an additional compliance measure called "person-months during which community water systems provide water that meets health-based standards." This measure is intended to take into account situations where violations are of short duration. Missouri is currently achieving 96.6 percent compliance with this new measure. The national target for federal fiscal year 2009 is 95 percent.

## Percent Population of Community Water Systems Meeting Health-based Standards

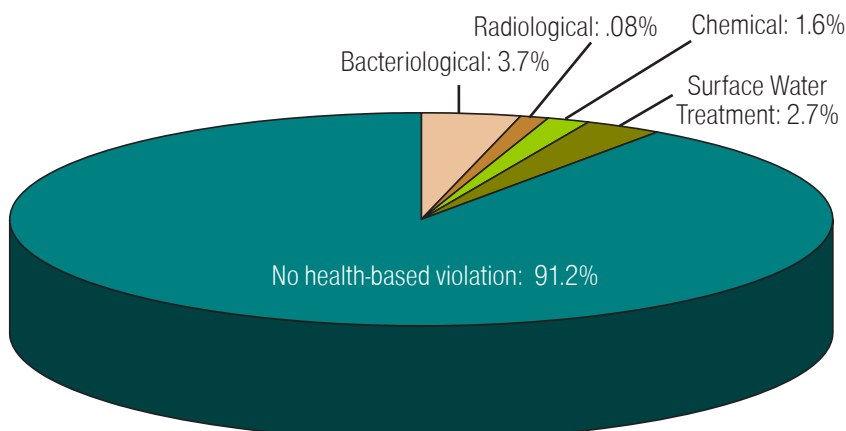

There is overlap in that some systems violate more than one area.

The majority of MCL and monitoring violations in 2008 were for failure to meet the requirements of the Total Coliform Rule. Total coliform bacteria serve as an indicator that disease-causing organisms may be present. All public water systems in the state must test for this type of bacteria every month they dispense water to the public. Monitoring violations are by far the most common violation for this rule. The department is particularly concerned when monitoring violations occur at public water systems that have a history of bacteriological contamination. Adequate testing is the only way to know for sure if the problems have been corrected or have reoccurred.


In 2008 1.4 percent, 40 public water systems, had acute violations for fecal coliform or E. coli. (Four of these systems had multiple acute MCL violations during the year, resulting in a total of 47 acute MCL violations.)

Another way to look at the number of acute MCL violations is to compare the number that actually occurred to the number possible. Since bacteriological testing is required monthly, the 2,782 water systems had more than 30,000 chances to get an E. coli MCL violation. The 47 that actually occurred represent one percent of the number possible. While these acute violations can be serious, they are rare.


Some people may be more vulnerable to waterborne illness than the general population. To educate the public on this issue, community water systems include a warning in their annual Consumer Confidence Reports stating that some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections.

## Drinking Water Trends

**Community Systems: Population Served Meeting All Health-Based Requirements**

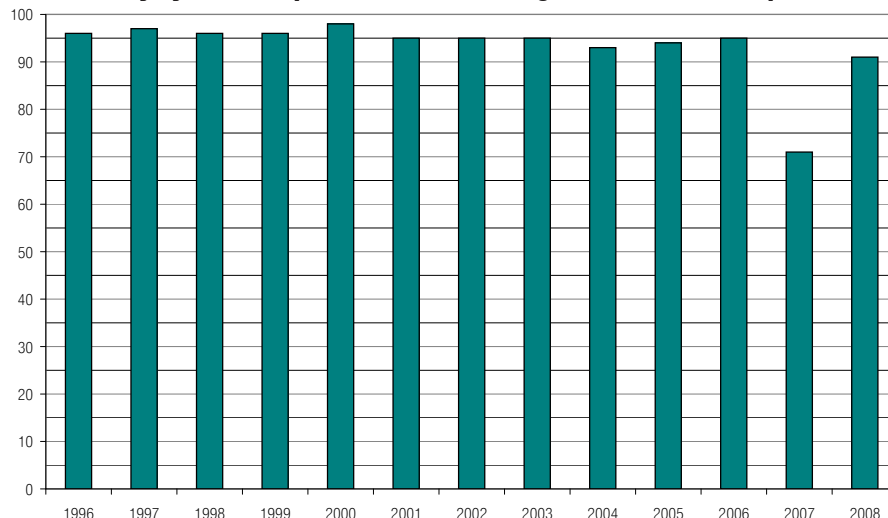

**E.coli/Fecal Coliform Acute MCL Violations**

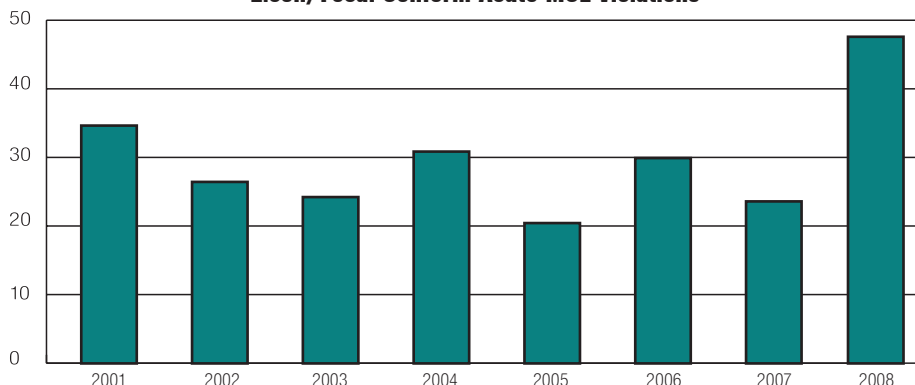

The Consumer Confidence Report provides detailed information about the specific community water system, while this report does not. Consumer Confidence Reports include specifics about the water system, including the source of drinking water and the levels of naturally occurring substances in drinking water. Usually these pose no health threat and are not violations. The report must list violations of state and federal requirements for that year. The department has made a concerted effort to provide technical assistance to small water systems through a circuit rider to help with CCR preparation and distribution. As a result, the overall CCR compliance rate has risen to 97 percent in 2008.

Anyone can request a copy of their report from their public water system or by calling the department's Public Drinking Water Branch at 1-800-361-4827 or 573-751-5331.

### Compliance Activities: Preserving the Quality of Drinking Water

The department works closely with violators to return them to compliance in a timely manner. This includes phone contacts, on-site inspections, meetings with owners or operators and technical assistance as needed. For the more serious violations, a Bilateral Compliance Agreement between the water system owner and the department is the tool used to move the system back into compliance. Bilateral Compliance



Agreements are written agreements negotiated between and signed by the system owner and department staff. This process allows the department to determine the improvements the water system needs to make without either party having to endure the time and cost of litigation.

If a water system owner or operator violates a Bilateral Compliance Agreement, the department implements a negotiated settlement policy. Negotiated settlement agreements are more formal and enforceable than Bilateral Compliance Agreements and are reviewed and signed by staff from the Missouri Attorney General's Office. If the negotiated settlement agreement is unsuccessful, the department refers the case for legal action through the courts.

Public Drinking Water Branch staff work in conjunction with other agencies to protect public health. By serving on a committee with staff from the Department of Health and Senior Services, the two agencies identify ways to support and benefit each other's activities. One of those areas is enforcement activity against facilities, such as restaurants, that are regulated by both agencies.

The department provides training and technical assistance in an effort to prevent the occurrence of violations. Training is routinely provided to operators and owners of public water systems around the state, primarily concentrating on the basic principles of running a water system, performing the required monitoring and preventing contamination of the system. Technical assistance in the form of phone contacts and on-site visits is also available to help water system operators avoid or correct problems. Staff in the department's regional and satellite offices carry out most of these activities.

For all violations, public water systems are required to notify the consumers they serve. The department provides all public water systems with the necessary forms and information to effectively notify the public. The method of notification varies by the violation and system type. Systems must report back to the department how the public notice was performed. Some violations, such as the confirmed detection of fecal coliform bacteria or E. coli, warrant immediate action due to the threat to public health. For such acute violations, the department requires systems to notify customers within 24 hours to boil water before consumption. Boil water orders remain in effect until the problem has been corrected and the water is safe to consume.

## For More Information

Information about Missouri's public water systems can be obtained by writing to the Missouri Department of Natural Resources, Public Drinking Branch, Water Protection Program, P.O. Box 176, Jefferson City, MO 65102 or calling 800-361-4827 or 573-751-5331. Information is also available on the department's Web site at [www.dnr.mo.gov/env/wpp/dw-index.htm](http://www.dnr.mo.gov/env/wpp/dw-index.htm).

## Summary of Violations Table

The following definitions apply to the Summary of Violations table.

**Filtered Systems:** Water systems that have installed filtration treatment [10 CSR 60-4.055].

**Inorganic Contaminants:** Non-carbon-based compounds such as metals, nitrates and asbestos. These contaminants are naturally-occurring in some water, but can get into water through farming, chemical manufacturing and other human activities. [10 CSR 60-4.030].

**Lead and Copper Rule:** Lead and copper corrosion pose various health risks when ingested at any level, and can enter drinking water from household pipes and plumbing fixtures [10 CSR 60, Chapter 15]. Violations are reported for: failure to monitor; failure to install optimal corrosion control treatment or a source water treatment system that would reduce lead and copper levels in water at the tap; failure to replace lead service lines on the schedule required by the regulation; and failure to provide required public education about reducing or avoiding lead intake from drinking water.

**Maximum Contaminant Level:** The highest amount of a contaminant allowed in drinking water. Maximum Contaminant Levels, or MCLs, ensure drinking water does not pose a health risk. MCLs are defined in milligrams per liter (parts per million) unless otherwise specified.



**Monitoring:** The department specifies which water testing methods the water systems must use and sets schedules for the frequency of testing. A water system that does not follow the department's schedule or methodology is in violation. [10 CSR 60-4.010]. States must report monitoring violations that are significant as determined by the EPA Administrator, in consultation with the department. For purposes of this report, significant monitoring violations are major violations and they occur when no samples are taken or no results are reported during a compliance period.

**Organic Contaminants:** Carbon-based compounds, such as industrial solvents and pesticides. These contaminants generally get into water through runoff from cropland or discharge from factories. [10CSR 60-4.040 and 4.100].

**Radionuclides:** Radioactive particles that can occur naturally in water or result from human activity. Safe drinking water regulations set maximum contaminant levels on five types of radionuclides: radium-226, radium-228, uranium, gross alpha and beta particle/photon radioactivity [10 CSR 60-4.060].

**Surface Water Treatment Rule:** This includes a series of rules promulgated from 1989-2006 that establish criteria under which water systems supplied by surface water sources, or groundwater sources under the direct influence of surface water, must filter and disinfect their water (Surface Water Treatment Rule, Interim Enhanced Surface Water Treatment Rule, Long Term 1 Enhanced Surface Water Treatment Rule, Long Term 2 Enhanced Surface Water Treatment Rule). [10 CSR 60-4.055]

Violations of the surface water treatment rules are reported for the following categories:

- Monitoring, routine/repeat (for filtered systems): Failure to carry out required tests or to report the results of those tests. A major monitoring violation for

the surface water treatment rule occurs when at least 90 percent of the required samples are not taken or results are not reported during the compliance period.

- Treatment techniques (for filtered systems): Failure to properly treat the water.

**Total Coliform Rule:** The Total Coliform Rule, or TCR, establishes regulations for microbiological contaminants in drinking water. These contaminants can cause a short-term health problem. If no samples are collected during the one-month compliance period, a major monitoring violation occurs. States report four categories of violations to EPA:

- Acute MCL violation: A violation where the system found fecal coliform or E. Coli, potentially harmful bacteria, in its water.
- Non-acute MCL violation: A violation where the system found total coliform in samples of its water at a frequency or at a level that violates the rule. For systems collecting fewer than 40 samples per

month, more than one positive sample for total coliform is a violation. For systems collecting 40 or more samples per month, more than 5 percent of the samples positive for total coliform violation.

- Major routine and follow-up monitoring: A violation where a system did not perform any monitoring.
- Sanitary Survey: A major monitoring violation if a system fails to collect five routine monthly samples if sanitary survey is not performed.

**Treatment Techniques:** A water disinfection process that EPA requires instead of a MCL for contaminants that laboratories cannot adequately measure. Failure to meet other operational and system requirements under the Surface Water Treatment and the Lead and Copper Rules have also been included in this category of violation for purposes of this report.

**Violation:** A failure to meet any state or federal drinking water regulation.



## Organic Contaminants: Jan. 1, 2008 - Dec. 31, 2008

		MCL		Treatment Technique		Significant Monitoring/Reporting	
	MCL <sup>1</sup> (mg/L)	Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations
Organic Contaminants				*			
1,1,1-Trichloroethane	0.2					0	0
1,1,2-Trichloroethane	0.005					0	0
1,1-Dichloroethylene	0.007					0	0
1,2,4-Trichlorobenzene	0.07					0	0
1,2-DBCP	0.0002						
1,2-Dichloroethane	0.005					0	0
1,2-Dichloropropane	0.005					0	0
2,3,7,8-TCDD (Dioxin)	3x10-8						
2,4,5-TP	0.05						
2,4-D	0.07						
Acrylamide							
Alachlor	0.002						
Atrazine	0.003						
Benzene	0.005	4	1			0	0
Benzo[a]pyrene	0.0002					0	
Carbofuran	0.04					0	
Carbon tetrachloride	0.005					0	0
Chlordane	0.002					0	
cis-1,2-Dichloroethylene	0.07					0	0
Dalapon	0.2					0	
Di(2-ethylhexyl)adipate	0.4					0	
Di(2-ethylhexyl)phthalate	0.006					0	
Dichloromethane	0.005					0	0
Dinoseb	0.007					0	
Diquat	0.02					0	
Endothall	0.1					0	
Endrin	0.002					0	
Epichlorohydrin							
Ethylbenzene	0.7					0	0
Ethylene dibromide							
Glyphosate	0.7						
Heptachlor	0.0004						
Heptachlor epoxide	0.0002						
Hexachlorobenzene							

<sup>1</sup> Values are in milligrams per liter (mg/L), unless otherwise specified

\*Shaded areas indicate a violation is not applicable in this category

## Organic Contaminants: Jan. 1, 2008 - Dec. 31, 2008

		MCL		Treatment Technique		Significant Monitoring/Reporting	
	MCL <sup>1</sup> (mg/L)	Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations
Hexachlorobenzene	0.001						
Lindane	0.0002						
Methoxychlor	0.04						
Monochlorobenzene	0.1					0	0
o-Dichlorobenzene	0.6					0	0
Oxamyl (Vydate)	0.2						
Para-Dichlorobenzene	0.075					0	0
Pentachlorophenol	0.001						
Picloram	0.5						
Simazine	0.004						
Styrene	0.1					0	0
Tetrachloroethylene	0.005					0	0
Toluene	1					0	0
Total PCB	0.0005						
Toxaphene	0.003						
Trans-1,2-Dichloroethylene	0.1					0	0
Trichloroethylene	0.005					0	0
Vinyl chloride	0.002					0	0
Xylenes (total)	10					0	0
Total trihalomethanes	0.80	24	11			2	2
Haloacetic acids	0.60	30	13			2	2
Disinfection byproducts		54	18	11	5		

<sup>1</sup> Values are in milligrams per liter (mg/L), unless otherwise specified

## Inorganic Contaminants: Jan. 1, 2008 - Dec. 31, 2008

		MCL		Treatment Technique		Significant Monitoring/Reporting	
	MCL (mg/L)	Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations
<b>Inorganic Contaminants</b>							
Antimony	0.006					0	0
Arsenic	0.010					0	0
Asbestos	7 million fibers/L						
Barium	2					0	0
Beryllium	0.004					0	0
Cadmium	0.005					0	0
Chromium	0.1					0	0
Cyanide (as free cyanide)	0.2					0	0
Fluoride	4.0	8	2			0	0
Mercury	0.002					0	0
Nitrate	10 (as nitrogen)						
Nitrite	1 (as nitrogen)						
Selenium	0.05					0	0
Thallium	0.002					0	0
Total nitrate and nitrite	10 (as nitrogen)					108	108

## Radiological Contaminants: Jan. 1, 2008 - Dec. 31, 2008

		MCL		Treatment Technique		Significant Monitoring/Reporting	
	MCL <sup>1</sup> (pCi/L)	Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations
<b>Radiological Contaminants</b>							
Gross Alpha	15pCi/L	54	17			25	15
Radium-226 and radium-228	5 pCi/L	71	22			25	15
Gross beta	4 mrem/yr						
Subtotal		125	22 <sup>2</sup>			50	15

## Microbiological Contaminants: Jan. 1, 2008 - Dec. 31, 2008

		MCL		Treatment Technique		Significant Monitoring/Reporting	
	MCL Presence/Absence	Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations
<b>Total Coliform Rule</b>							
Acute MCL violation	Presence	47	40				
Non-acute MCL violation	Presence	509	341				
Major routine and follow up Monitoring						851	507
Sanitary survey <sup>3</sup>							
Subtotal		556	341 <sup>4</sup>			851	507

<sup>1</sup> Values are in Picocuries per liter (pCi/L), unless otherwise specified

<sup>2</sup> Some systems may have violations in multiple categories

<sup>3</sup> Number of violations for failure to perform sanitary survey under the Total Coliform Rule.

<sup>4</sup> All Systems with an acute MCL violation also had a non-acute monthly MCL violation for the same month



## Surface Water Treatment Rule: Jan. 1, 2008 - Dec. 31, 2008

		MCL		Treatment Technique		Significant Monitoring/Reporting	
	MCL	Number of Violations	Number of Systems with Violation	Number of Violations	Number of Systems with Violation	Number of Violations	Number of Systems with Violation
<b>Surface Water Treatment</b>							
Filtered systems							
Monitoring, routine/repeat						0	0
Treatment techniques				16	9		
Unfiltered systems							
Monitoring, routine/repeat							
Failure to filter							
Subtotal				16	9	0	0

## Lead and Copper Rule: Jan. 1, 2007 - Dec. 31, 2007

		MCL		Treatment Technique		Significant Monitoring/Reporting	
	MCL	Number of Violations	Number of Systems with Violation	Number of Violations	Number of Systems with Violation	Number of Violations	Number of Systems with Violation
<b>Lead and Copper Rule <sup>1</sup></b>							
Initial lead and copper tap monitoring and reporting						15	15
Follow-up or routine lead and copper tap monitoring and reporting						8	8
Treatment installation							
Public education							
Subtotal						23	23

<sup>1</sup> Includes any system not up to date on lead and copper monitoring. Not comparable with Annual Compliance Report figures from 2007

## Public Notification: Jan. 1, 2008 - Dec. 31, 2008

		MCL		Treatment Techniques		Significant Monitoring/Reporting	
	MCL	Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations
<b>Public Notification</b>							
Consumer Confidence Reports <sup>1</sup>						43	43
Subtotal						323	227

<sup>1</sup> Violations for failure to produce and distribute the 2007 Consumer Confidence Report in 2008

## Appendix A - MCL Violations - Acute

### I. Coliform MCL Violations - Acute

The following systems were under boil water orders due to acute MCL violations for fecal coliform or E. coli bacteria for the months listed. These acute violations also violate the standard for total coliform bacteria.

County	ID#	System Name	Month(s)	Issue	Rescind
Barry	MO 5211301	Kings Harbor Resort	July	7/28/2008	8/1/2008
	MO 5190895	Lazy Eagle Resort	October	10/27/2008	11/7/2008
Benton	MO 3201440	The Old Oar House Inn	July	<sup>1</sup>	<sup>2</sup>
	MO 3201440	The Old Oar House Inn	August	<sup>1</sup>	<sup>2</sup>
	MO 3201440	The Old Oar House Inn	May	3/20/2008	<sup>2</sup>
	MO 3201440	The Old Oar House Inn	March	3/20/2008	<sup>2</sup>
	MO 3031333	Big Bear Estates	August	9/2/2008	9/8/2008
Camden	MO 3212416	Halfway Inn	May	6/6/2008	6/12/2008
	MO 5242623	Little Niangua Campground	April	5/5/2008	6/6/2008
	MO 3238092	Osage Heritage Condominiums	April	4/17/2008	4/24/2008
	MO 3238092	Osage Heritage Condominiums	June	6/9/2008	6/16/2008
	MO 5031578	McGinnis Estates Subdivision	April	4/16/2008	8/4/2008
Christian	MO 5171805	Plainview Elem School	April	4/11/2008	2/6/2009
Franklin	MO 6242645	Camp Trinity	March	<sup>3</sup>	
	MO 6242645	Camp Trinity	September	10/10/2008	10/31/2008
	MO 6010620	Pacific	May	<sup>4</sup>	
Greene	MO 5258164	Expressway Stop	June	6/26/2008	7/1/2008
	MO 5292347	Jump Stop #309	November	11/10/2008	11/17/2008
	MO 5292347	Jump Stop #309	December	12/31/2008	1/15/2009
Hickory	MO 5238302	Fugate Mobile Home Park	April	4/28/2008	5/5/2008
Jasper	MO 5218143	Royal Oaks Arena	July	8/4/2008	7/20/2009
	MO 5292829	Star Pump And Pantry	January	1/18/2008	4/8/2008
Lawrence	MO 5292588	KCS Enterprises Inc	January	1/14/2008	2/22/2009
	MO 5041314	Youngberg Estates MHP	June	6/9/2008	6/23/2008
McDonald	MO 5182602	Gallery Graphics Inc	September	9/8/2008	9/26/2008
	MO 5290183	Kings C Store	June	6/16/2008	2/26/2009
Montgomery	MO 3281053	Loutre Shore Country Club	April	4/21/2008	4/25/2008
Morgan	MO 5031436	10 4 Water System	March	3/10/2008	3/18/2008
	MO 3031259	Stillwater Subdivision	May	6/2/2008	6/6/2008
Newton	MO 5048224	Town & Country MHP	May	6/2/2008	6/9/2008
Osage	MO 3024439	Osage Co PWSD #3	July	7/18/2008	7/22/2008
Reynolds	MO 4190878	Wilderness Lodge Limited Rivers Edge	July	7/25/2008	7/29/2008
Scott	MO 4010971	Haywood City	May	5/27/2008	6/12/2008
St Charles	MO 6010919	Weldon Spring Heights Village	May	5/30/2008	6/11/2008
Stone	MO 5190611	Bristol Oaks Express & Porkys BBQ	June	6/20/2008	6/27/2008
	MO 5191413	Christian Associates Of Table Rock Lake	July	7/29/2008	8/4/2008
	MO 5190965	Cottage Resort	July	7/29/2008	8/1/2008
	MO 5199993	Crest Lodge Resort	April	4/25/2008	5/21/2008
	MO 5238311	Dogwood Valley Estates	June	7/7/2008	7/11/2008
	MO 5191964	Lynn/White Oak	September	9/24/2008	10/10/2008
	MO 5036090	Village Of Coney Island	July	7/29/2008	8/4/2008
	MO 5282768	Oakmont Hills PWS	November	12/1/2008	12/8/2008
	MO 5191988	Rustic Acres	June	7/2/2008	<sup>2</sup>
	MO 5191988	Rustic Acres	September	10/2/2008	<sup>2</sup>
Taney	MO 5282831	Sweet Pea Day Care	March	4/4/2008	5/16/2008
	MO 5191032	Taneycomo Lakefront Resort	May	6/2/2008	6/19/2008
	MO 5010218	Diggins	May	5/27/2008	6/12/2008

<sup>1</sup> Boil order in effect when subsequent violation occurred.


<sup>2</sup> Boil order in effect at present time

<sup>3</sup> Boil order not issued; system agreed not to dispense water.

<sup>4</sup> System failed to notify department of violation. Notice of Violation issued to system.

## 2008 Boil Water Orders

Issued due to acute MCL violations of the Total Coliform Rule and the Surface Water Treatment Rule

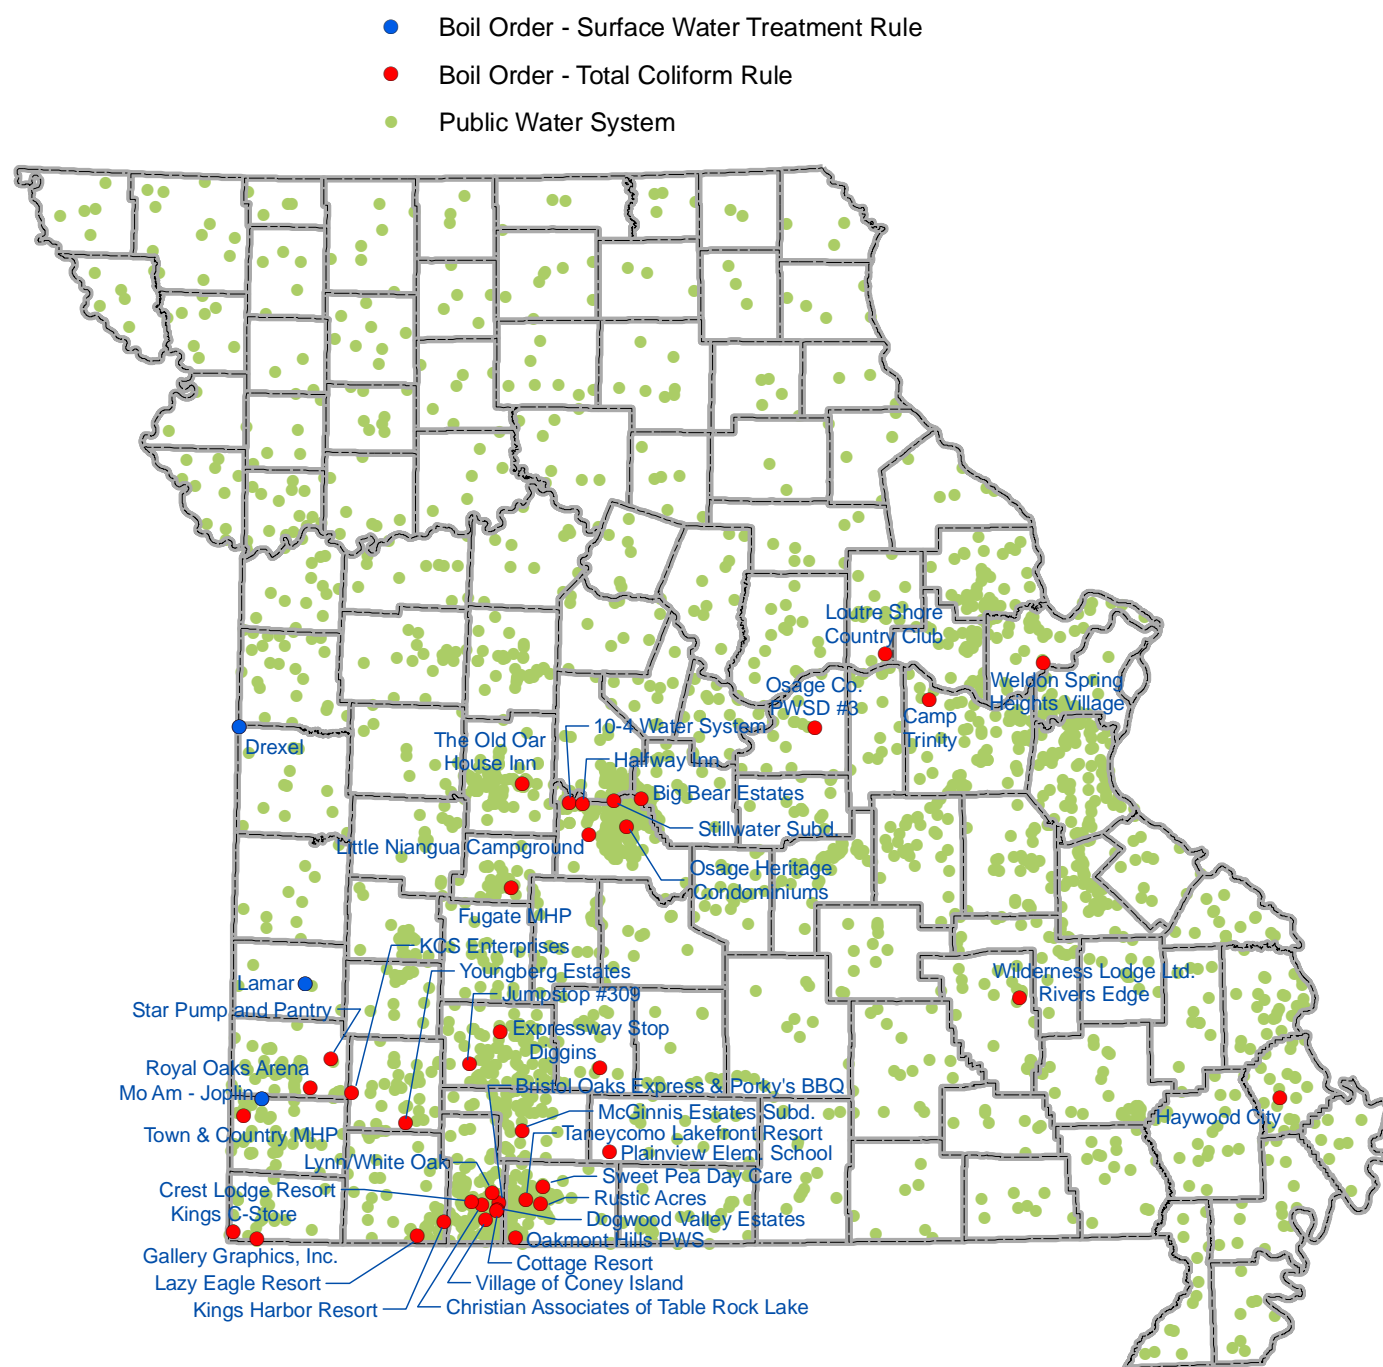

For current boil water orders, check the department's Web page at [www.dnr.mo.gov/env/wpp/boil/index.html](http://www.dnr.mo.gov/env/wpp/boil/index.html)

## Appendix A - MCL Violations Non-Acute

### I. Coliform MCL Violations

The following systems had two or more samples test positive for total coliform bacteria in the months indicated.

County	Id#	System Name	Month(s)
Barry	MO 5010837	Washburn	September
	MO 5010837	Washburn	October
	MO 5010856	Wheaton	July
	MO 5031084	Roaring River Homeowners Assn Inc	September
	MO 5031084	Roaring River Homeowners Assn Inc	October
	MO 5031084	Roaring River Homeowners Assn Inc	November
	MO 5031105	Needles Eye Beach	June
	MO 5036300	Oaks Homeowners Assn Water Dist	January
	MO 5111947	Table Rock Viola Park 128	June
	MO 5112269	Table Rock Big M Park 103	April
	MO 5112269	Table Rock Big M Park 103	May
	MO 5190895	Lazy Eagle Resort	October
	MO 5211301	Kings Harbor Resort	June
	MO 5211301	Kings Harbor Resort	July
	MO 5211485	Timberoc Village Shopping Center	October
	MO 5211851	Office Pub & Steakhouse	June
	MO 05241299	Shoreline Campground And Resort	June
	MO 5252497	Eagle Point Property Owners Assn	July
	MO 5252577	ABC Water Association	October
	MO 5258287	Viola R V & Mobile Home Park	September
	MO 5258290	Kings View Subdlvision	May
	MO 5258290	Kings View Subdlvision	October
	MO 5292405	Jenkins Kwik Stop	July
	MO 5292464	Uncle Dales	June
Bates	MO 1024031	Bates Co PWSD #2	September
Benton	MO 1031536	Oak Ridge Acres	June
	MO 1031536	Oak Ridge Acres	July
	MO 1031536	Oak Ridge Acres	December
	MO 1041486	Grateful Valley MHP & RV Camp	April
	MO 1202872	Warsaw Shrine Club	September
	MO 1202872	Warsaw Shrine Club	October
	MO 1212779	Valley Bar And Grill	February
	MO 1212779	Valley Bar And Grill	March
	MO 1212779	Valley Bar And Grill	April
	MO 1212779	Valley Bar And Grill	May
	MO 1212806	Lost Acres (Vikings)	November
	MO 1212806	Lost Acres (Vikings)	December
	MO 1212833	Dianthas Country Kitchen	August
	MO 1212833	Dianthas Country Kitchen	September
	MO 1212915	Charleys Buffet	August
	MO 1212915	Charleys Buffet	September
	MO 1212915	Charleys Buffet	October
	MO 1292877	R Corner	September
	MO 1292877	R Corner	October
	MO 3010400	Ionia	July
	MO 3036072	Lakeview Heights Subd	February
	MO 3036072	Lakeview Heights Subd	June
	MO 3040761	Lake Hills MH/RV Park	December



<b>County</b>	<b>Id#</b>	<b>System Name</b>	<b>Month(s)</b>
Barry (continued)	MO 3142486	Lost Valley Hatchery	July
	MO 3192004	Forthview Resort	June
	MO 3201440	The Old Oar House Inn	March
	MO 3201440	The Old Oar House Inn	April
	MO 3201440	The Old Oar House Inn	May
	MO 3201440	The Old Oar House Inn	June
	MO 3201440	The Old Oar House Inn	July
	MO 3201440	The Old Oar House Inn	August
	MO 3201440	The Old Oar House Inn	September
	MO 3201440	The Old Oar House Inn	October
	MO 3210344	Dars Cafe	June
	MO 3241430	Eagles Nest RV Resort	January
	MO 3241430	Eagles Nest RV Resort	March
	MO 3291407	Hot Spot #1	October
Bollinger	MO 4172719	New Salem Baptist Church & School	February
	MO 4172719	New Salem Baptist Church & School	August
Butler	MO 4010278	Fisk	September
	MO 4024070	Butler Co PWSD #1	August
	MO 4191461	Millers Motor Lodge	October
Callaway	MO 3048994	New Christian Life Fellowship	September
Camden	MO 3031091	Greenview Bay Subd	June
	MO 3031220	Seven Trails West Subd	November
	MO 3031297	St Moritz On The Lake	June
	MO 3031297	St Moritz On The Lake	July
	MO 3031333	Big Bear Estates	August
	MO 3031333	Big Bear Estates	October
	MO 3031333	Big Bear Estates	November
	MO 3031333	Big Bear Estates	December
	MO 3036216	Sioux Trails	October
	MO 3190682	Alhonna Resort	June
	MO 3190682	Alhonna Resort	July
	MO 3190682	Alhonna Resort	September
	MO 3190694	El Kay Lake View Motel	August
	MO 3190708	Lone Oak Point Condominiums	July
	MO 3190784	Lake Breeze Resort	June
	MO 3191521	Lakeview Beach Resort	September
	MO 3192351	Dogwood Acres Resort	August
	MO 3198084	Deepwater Inn	July
	MO 3198175	Captain Rons	August
	MO 3208008	Lake Valley Country Club	July
	MO 3211105	The Potted Steer	August
	MO 3212294	Backwater Jacks Bar & Grill	April
	MO 3212416	Halfway Inn	May
	MO 3212446	Red Fox Bar & Grill	October
	MO 3212446	Red Fox Bar & Grill	November
	MO 3212580	The Storage Shed	August
	MO 3218036	The Blue Heron Rest	July
	MO 3238092	Osage Heritage Condominiums	April
	MO 3238092	Osage Heritage Condominiums	June
	MO 3238170	Parkside Place Condo	August
	MO 3240006	Red Oak Resort	November
	MO 3258245	Kings Plaza	August
	MO 3262166	Montgomery Big Valley Cove	July

<b>County</b>	<b>Id#</b>	<b>System Name</b>	<b>Month(s)</b>
Camden (continued)	MO 3281046	Lakeshore Plaza	July
	MO 5031469	Oakwood Hills Subdlvision	July
	MO 5031528	Seven Hills Apartments	May
	MO 5031528	Seven Hills Apartments	June
	MO 5031528	Seven Hills Apartments	August
	MO 5031544	Oak Shadows Subdlvision	June
	MO 5031544	Oak Shadows Subdlvision	December
	MO 5212764	Its Twelve Oclock Somewhere	May
	MO 5212764	Its Twelve Oclock Somewhere	August
	MO 5212764	Its Twelve Oclock Somewhere	November
	MO 5212764	Its Twelve Oclock Somewhere	December
	MO 5212785	Crossroads Cafe And C Store	July
	MO 5212796	Bear Bottom Resort	June
	MO 5212796	Bear Bottom Resort	November
	MO 5242623	Little Niangua Campground	April
	MO 5242623	Little Niangua Campground	August
	MO 5252622	Niangua Point Water Association	August
	MO 5252902	Sunset Shores	October
	MO 5252903	Ke Jo #IV Hoa	May
	MO 5252903	Ke Jo #IV Hoa	June
	MO 5252903	Ke Jo #IV Hoa	July
	MO 4079503	Mid America Teen Challenge	November
	MO 4079503	Mid America Teen Challenge	December
Cape	MO 4024109	Carter Co PWSD #2	March
Carter	MO 4024109	Carter Co PWSD #2	November
Cass	MO 1010301	Garden City	July
	MO 1010349	Harrisonville	May
	MO 1024110	Cass Co PWSD #10	August
Cedar	MO 5024120	Cedar Co PWSD #1	July
	MO 5036164	Stockton Hills Water Co	January
	MO 5036164	Stockton Hills Water Co	September
	MO 5036164	Stockton Hills Water Co	December
	MO 5191320	Mt Carmel Inn	November
	MO 5238288	39 Mobile Home Park	July
	MO 5282827	Vikings Office Bar Post 129	October
Chariton	MO 2010420	Keytesville	July
Christian	MO 5010071	Billings	October
	MO 5024134	Highlandville	April
	MO 5031330	Blue Stem Estates Subd	April
	MO 5031464	Wood Ridge	May
	MO 5031578	McGinnis Estates Subdivision	March
	MO 5031578	McGinnis Estates Subdivision	April
	MO 5031578	McGinnis Estates Subdivision	May
	MO 5031578	McGinnis Estates Subdivision	June
	MO 5036305	Pippenville & Oak Park Owners Assn	December
	MO 5048154	Sparta MHP	June
	MO 5102421	USFS Cobb Ridge Rec Area	April
	MO 5102421	USFS Cobb Ridge Rec Area	May
	MO 5102421	USFS Cobb Ridge Rec Area	June
	MO 5258307	BC Fastop	June
	MO 5282886	Sanctuary Development	April
	MO 5291585	Cowboy Corral	September

<b>County</b>	<b>Id#</b>	<b>System Name</b>	<b>Month(s)</b>
Clay	MO 1010416	Kearney	September
	MO 1024142	Clay Co PWSD #2	October
Cole	MO 3010257	Eugene	September
	MO 3010831	Wardsville	November
Crawford	MO 3024160	Cole Co PWSD #2	August
	MO 4202887	Holiday Lake RV Park	April
	MO 4202887	Holiday Lake RV Park	May
	MO 4202887	Holiday Lake RV Park	June
	MO 4242910	Lucky Clover River Resort Inc	August
	MO 4242910	Lucky Clover River Resort Inc	September
	MO 4292900	Fanning 66 Outpost LLC	June
	MO 4292900	Fanning 66 Outpost LLC	July
	MO 4292900	Fanning 66 Outpost LLC	August
	MO 6190795	Birds Nest Lodge	July
	MO 5010331	Greenfield	September
Dade	MO 5010331	Greenfield	November
	MO 5218053	Mr Eds Drive In	September
Dallas	MO 5282882	The Corner	February
	MO 5010040	Ava	August
Douglas	MO 5171805	Plainview Elem School	April
	MO 5282625	C L Discount Grocery	September
	MO 4010022	Arbyrd	August
Dunklin	MO 4024209	Dunklin Co PWSD #3 South	November
	MO 6010620	Pacific	April
Franklin	MO 6010620	Pacific	May
	MO 6010708	St Clair	May
	MO 6010708	St Clair	October
	MO 6010801	Union	October
	MO 6010801	Union	November
	MO 6010838	Washington	November
	MO 6031090	Laura Meadows Apartments	June
	MO 6031237	Hayfield Water Works	June
	MO 6036041	Melody Lake Subdivision	September
	MO 6036128	Miramiguoa Park	November
	MO 6079502	Longview Animal Nutrition Center	September
	MO 6079502	Longview Animal Nutrition Center	October
	MO 6212407	Hwangs Wok	June
	MO 6212407	Hwangs Wok	November
	MO 6240129	Native Experience Campground	May
	MO 6242645	Camp Trinity	March
	MO 6242645	Camp Trinity	September
Gasconade	MO 6010302	Gasconade	June
	MO 6010618	Owensville	May
	MO 6010618	Owensville	September
	MO 6171595	Owensville High School	November
	MO 6211503	Silver Dollar Lounge	June
Greene	MO 5010768	Strafford	September
	MO 5010768	Strafford	October
	MO 5024231	Greene Co PWSD #6	July
	MO 5036174	Willard Meadows Water Company	September
	MO 5036187	Cross Roads Acres	April
	MO 5036187	Cross Roads Acres	May
	MO 5036218	The Landing Subdivision	May
	MO 5036218	The Landing Subdivision	June

<b>County</b>	<b>Id#</b>	<b>System Name</b>	<b>Month(s)</b>
Greene (continued)	MO 5036241	Peace Of Mind Estates	August
	MO 5036304	Pembrook Village Subd	May
	MO 5036304	Pembrook Village Subd	June
	MO 5048145	Silver Bell Mobile Home Park	July
	MO 5182849	JM & M Investments	July
	MO 5182849	JM & M Investments	September
	MO 5210110	Springfield Skateland	August
	MO 5218149	American Legion Post #676	March
	MO 5258072	Codys #22	August
	MO 5258164	Crossroads Convenience Store	June
	MO 5272913	Pleasant View Church Of Christ	May
	MO 5282754	JD Lee & Sons Funeral Home	August
	MO 5282754	JD Lee & Sons Funeral Home	October
	MO 5292347	Jump Stop #309	October
	MO 5292347	Jump Stop #309	November
	MO 5292347	Jump Stop #309	December
	MO 5292838	Compass Plaza	July
	MO 5292838	Compass Plaza	August
	MO 5292838	Compass Plaza	September
Harrison	MO 1010306	Gilman City	December
Henry	MO 1010865	Windsor	December
Hickory	MO 5021292	PWSD #2 Of Hickory Co	September
	MO 5238302	Fugate Mobile Home Park	April
	MO 5251522	Bohanna Heights Subdlvision	March
Holt	MO 5251522	Bohanna Heights Subdlvision	April
	MO 1010489	Maitland	December
	MO 1021304	Holt Co PWSD # 1	July
Howell	MO 4024264	Howell Co PWSD #1	June
Iron	MO 6102141	USFS Council Bluff Beach	September
Jackson	MO 1010589	Oak Grove	June
Jasper	MO 5024287	Jasper Co PWSD #2	June
	MO 5180607	Dyno Nobel	September
	MO 5180607	Dyno Nobel	December
	MO 5218143	Royal Oaks Arena	July
	MO 5218143	Royal Oaks Arena	August
	MO 5272301	Bykota Church	May
	MO 5272301	Bykota Church	June
	MO 5292829	Star Pump And Pantry	January
Jefferson	MO 6036028	Lake Lorraine Water Co	September
	MO 6036031	Summer Set Utility Co	October
	MO 6036031	Summer Set Utility Co	November
	MO 6036042	Ficken Hill Subd	July
	MO 6036049	Lakewood Hills Subdivision	July
	MO 6036049	Lakewood Hills Subdivision	August
	MO 6036062	Scotsdale Subdivision	August
	MO 6036081	Meadow Drive Subdivision	May
	MO 6036081	Meadow Drive Subdivision	June
	MO 6036084	Warren Woods Subdivision	July
	MO 6036148	Ware Lake Subdivision	September
	MO 6036271	Raintree Plantation	November
	MO 6048142	D & J MHP	June
	MO 6048252	Cedar Hill Estates Water	September
	MO 6048252	Cedar Hill Estates Water	October



<b>County</b>	<b>Id#</b>	<b>System Name</b>	<b>Month(s)</b>
Jefferson (continued)	MO 6180934	River Cement Company	September
	MO 6240040	Camp Cedarledge	June
	MO 6291426	Festus Fuel & Food Mart	August
	MO 6291426	Festus Fuel & Food Mart	September
Johnson	MO 1079501	Whiteman Air Base	July
Laclede	MO 5010185	Conway	July
	MO 5010185	Conway	August
	MO 5010185	Conway	September
Lawrence	MO 5212472	Elson Inc DBA Midway Restaurant	January
	MO 5041314	Youngberg Estates MHP	January
	MO 5041314	Youngberg Estates MHP	March
	MO 5041314	Youngberg Estates MHP	April
	MO 5041314	Youngberg Estates MHP	May
	MO 5041314	Youngberg Estates MHP	June
	MO 5041314	Youngberg Estates MHP	July
	MO 5041314	Youngberg Estates MHP	September
	MO 5212358	Route 66 Tavern	February
	MO 5212358	Route 66 Tavern	March
	MO 5218165	Honeycreek Golf Club	September
	MO 5248289	Camp Wakonda	June
	MO 5248289	Camp Wakonda	August
	MO 5292360	Stop & Shop	February
	MO 5292360	Stop & Shop	March
	MO 5292360	Stop & Shop	April
	MO 5292588	KCS Enterprises Inc	January
Lincoln	MO 6036217	Lakeview Subdivision Water System	April
Madison	MO 4100013	USFS Silver Mines Camp	September
Maries	MO 3031246	Martin Subdivision	August
McDonald	MO 5021113	McDonald Co PWSD #2	October
	MO 5031173	Sky Blue Water Inc	June
	MO 5182602	Gallery Graphics Inc	September
	MO 5290183	Kings C Store	June
	MO 5290183	Kings C Store	September
	MO 5292748	Dass Liquor	April
	MO 5292748	Dass Liquor	May
	MO 3048243	Eagle MHP	April
	MO 3048243	Eagle MHP	July
	MO 3048243	Eagle MHP	August
Miller	MO 3178192	Our Lady Of The Snow School	February
	MO 3178192	Our Lady Of The Snow School	April
	MO 3178192	Our Lady Of The Snow School	June
	MO 3190833	Spinnaker Point	May
	MO 3191546	Beachcomber Resort	May
	MO 3231730	Village Marina	March
	MO 3240814	North Shore RV Park And Campground	July
	MO 3250943	Summerhaven Condominium Owners Assn	August
	MO 3291408	Ricks C Store & More	October
	MO 5301479	Atlantis Condominiums	July
Mississippi	MO 4010067	Bertrand	April
	MO 4021178	Mississippi Co PWSD #1	March
Moniteau	MO 3010791	Tipton	June
	MO 3010791	Tipton	September
	MO 3010791	Tipton	December

<b>County</b>	<b>Id#</b>	<b>System Name</b>	<b>Month(s)</b>
Montgomery	MO 3011121	Rhineland	December
	MO 3281053	Loutre Shore Country Club	April
	MO 3281053	Loutre Shore Country Club	May
	MO 3281053	Loutre Shore Country Club	June
	MO 6292898	J D Streett #170	July
	MO 6292898	J D Streett #170	August
	MO 6292898	J D Streett #170	September
Morgan	MO 3010767	Stover	October
	MO 3031259	Stillwater Subdlvision	May
	MO 3031358	Ivy Bend Water Association	May
	MO 3031358	Ivy Bend Water Association	September
	MO 3212558	Lehmans Restaurant	May
	MO 3218268	Osage River Bar & Grill	August
	MO 3252169	Lucky Point	September
	MO 5031436	10 4 Water System	March
	MO 5031436	10 4 Water System	August
	MO 5031454	Bendco Cove	January
	MO 5031454	Bendco Cove	August
	MO 5212905	Vinnys Cafe And Lounge	April
New Madrid	MO 4010304	Gideon	October
	MO 4010543	Morehouse	July
	MO 4024415	New Madrid Co PWSD #1	May
	MO 4024419	New Madrid Co PWSD #5	July
	MO 4024419	New Madrid Co PWSD #5	September
Newton	MO 5048224	Town & Country MHP	May
	MO 5048974	Tee Pee Reservation MHP	June
	MO 5048974	Tee Pee Reservation MHP	July
	MO 5182750	Heritage Oak Flooring	June
	MO 5182750	Heritage Oak Flooring	July
	MO 5212860	The Jungle	May
	MO 5212860	The Jungle	June
	MO 5212860	The Jungle	July
	MO 5212860	The Jungle	August
	MO 5242919	Blue Sky RV Park	October
	MO 5242919	Blue Sky RV Park	November
	MO 5242919	Blue Sky RV Park	December
	MO 5291268	Christines Conoco	August
	MO 5291268	Christines Conoco	September
Oregon	MO 4024433	Oregon Co PWSD #2	May
Osage	MO 3010517	Meta	July
	MO 3010517	Meta	December
	MO 3024439	Osage Co PWSD #3	July
	MO 3024439	Osage Co PWSD #3	October
	MO 3024439	Osage Co PWSD #3	November
Ozark	MO 3024439	Osage Co PWSD #3	December
	MO 5030209	Sundown Village Of	April
	MO 5100022	USFS North Fork Recreation Area	June
	MO 5100022	USFS North Fork Recreation Area	August
	MO 5100022	USFS North Fork Recreation Area	September
	MO 5191387	Theodosia Marina Resort Inc	June
	MO 5201082	Rainbow Trout & Game Ranch	July
	MO 5202448	Theodosia Country Club	March
	MO 5202448	Theodosia Country Club	April

<b>County</b>	<b>Id#</b>	<b>System Name</b>	<b>Month(s)</b>
Pettis	MO 1272873	Camp Branch Baptist Church	January
	MO 1272873	Camp Branch Baptist Church	May
	MO 1272873	Camp Branch Baptist Church	June
	MO 1272873	Camp Branch Baptist Church	July
	MO 3010332	Green Ridge	August
	MO 3010386	Hughesville	October
	MO 3021332	Pettis/Johnson/Saline PWSD #1	February
	MO 3036234	Hidden Hills Estates	May
	MO 3036234	Hidden Hills Estates	June
	MO 3218195	Dickie Doo Bar B Que	September
	MO 3218195	Dickie Doo Bar B Que	October
Phelps	MO 3031211	Sugar Tree Club	February
	MO 3031211	Sugar Tree Club	July
	MO 3031211	Sugar Tree Club	November
	MO 3048123	Stately Mansion Mobile Villa	March
	MO 3048124	Tanglewood Mobile Court	September
	MO 3048132	Scenic View MHP	November
	MO 3069014	Ferndale Residential Care II	September
	MO 3069014	Ferndale Residential Care II	October
	MO 3100012	USFS Mill Creek	May
	MO 3130528	Doolittle I 44 Rest Area	October
Pike	MO 2180565	Holcim Us Inc	July
Polk	MO 5010387	Humansville	September
Pulaski	MO 3202484	Oak Hills Country Club	May
Randolph	MO 2010533	Moberly	August
Reynolds	MO 4100015	USFS Sutton Bluff Rec Area	October
	MO 4181464	Bunker Wood Products	January
	MO 4190874	Black River Lodge Inc	June
	MO 4190878	Wilderness Lodge Limited Rivers Edge	July
Scott	MO 4010062	Benton	June
	MO 4010604	Oran	August
	MO 4010814	Vanduser	August
	MO 4010971	Haywood City	May
	MO 4010971	Haywood City	July
	MO 4010971	Haywood City	August
Shannon	MO 4010867	Winona	August
	MO 4248525	Jason Place Campground	August
St Charles	MO 6010919	Weldon Spring Heights Village	February
	MO 6010919	Weldon Spring Heights Village	March
	MO 6010919	Weldon Spring Heights Village	April
	MO 6010919	Weldon Spring Heights Village	May
	MO 6011535	St Paul	July
	MO 6036022	Prairie View Acres Subdivision	January
St Clair	MO 6202782	Broemmelsiek Park	July
	MO 5010480	Lowry City	October
	MO 5010480	Lowry City	November
St Francois	MO 4024539	St Francois Co PWSD #2	May
	MO 4036059	Terre Du Lac	May
	MO 4036059	Terre Du Lac	July
St Louis	MO 4069041	Farmington Correctional Center	July
	MO 6069092	Camp Wyman	April
	MO 6202395	Lone Elk County Park	July
	MO 6202395	Lone Elk County Park	August
	MO 6291618	Wildhorse Creek Amoco	August

<b>County</b>	<b>Id#</b>	<b>System Name</b>	<b>Month(s)</b>
Ste Genevieve	MO 4010710	Ste Genevieve	September
	MO 4010718	St Marys	June
	MO 4010718	St Marys	October
	MO 4036146	Lake Forest Estates	March
	MO 4282793	Crown Valley Winery	February
Stone	MO 4282793	Crown Valley Winery	March
	MO 5010192	Crane	April
	MO 5024591	Mo Ark Water Co	September
	MO 5030178	West Branson Bluffs Resort	February
	MO 5030870	Country Time Estates	November
	MO 5031103	Rainbow Hills	October
	MO 5031446	Stone Co Country Meadows HOA Inc	July
	MO 5031446	Stone Co Country Meadows HOA Inc	August
	MO 5031446	Stone Co Country Meadows HOA Inc	September
	MO 5036090	Village Of Coney Island	July
	MO 5036188	Holiday Hills of Stone County	February
	MO 5036201	Stonebridge West Subd	July
	MO 5100028	USFS Big Bay Campground	July
	MO 5100028	USFS Big Bay Campground	September
	MO 5110280	Table Rock Campbell Pt 126	May
	MO 5112267	Table Rock Indian Point 114	May
	MO 5190611	Bristol Oaks Express & Porkys BBQ	June
	MO 5190611	Bristol Oaks Express & Porkys BBQ	October
	MO 5190965	Cottage Resort	July
	MO 5190976	Four Seasons Resorts	May
	MO 5191312	Calm Waters Resort	July
	MO 5191413	Christian Associates Of Table Rock Lake	July
	MO 5191964	Lynn/White Oak	September
	MO 5199993	Crest Lodge Resort	April
	MO 5212501	Bearded Clam Restaurant	July
	MO 5238311	Dogwood Valley Estates	June
	MO 5240075	Deer Run Motel	June
	MO 5258134	Carr Lane Country Stop	June
	MO 5290224	Wagners One Stop	May
Taney	MO 5021379	Savannah Place Third Addition	June
	MO 5024600	Taney Co PWSD #2	May
	MO 5031149	Fall Creek Heights Subd	June
	MO 5036223	Taney Co Utilities Corp #2	March
	MO 5041129	Hidden Ridge Estates MHP	August
	MO 5048161	Bull Creek Village	July
	MO 5048344	Rolling Meadows	July
	MO 5048344	Rolling Meadows	August
	MO 5070683	Deer Run Apts	November
	MO 5171231	Bradleyville R I School	January
	MO 5171231	Bradleyville R I School	September
	MO 5171231	Bradleyville R I School	November
	MO 5191005	Parkview Lodge	September
	MO 5191032	Taneycomo Lakefront Resort	May
	MO 5191988	Rustic Acres	May
	MO 5191988	Rustic Acres	June
	MO 5191988	Rustic Acres	September
	MO 5191988	Rustic Acres	October
	MO 5211978	Hitch N Post General Store	July



<b>County</b>	<b>Id#</b>	<b>System Name</b>	<b>Month(s)</b>
Taney (Continued)	MO 5240145	Clevenger Branch Members Corp	July
	MO 5252920	Big Bear Estates POA	July
	MO 5252920	Big Bear Estates POA	August
	MO 5252920	Big Bear Estates POA	October
	MO 5258138	Rapid Roberts #104	January
	MO 5258138	Rapid Roberts #104	June
	MO 5282768	Oakmont Hills PWS	September
	MO 5282768	Oakmont Hills PWS	November
	MO 5282831	Sweet Pea Day Care	March
	MO 5292494	Wild Bills Travel Center	October
Texas	MO 4010382	Houston	June
	MO 4024607	Texas Co PWSD #2	September
	MO 4272906	Cabool Second Baptist Church & Daycare	August
	MO 4272906	Cabool Second Baptist Church & Daycare	September
Warren	MO 6010505	Marthasville	October
	MO 6010799	Truesdale	July
	MO 6010799	Truesdale	September
	MO 6010834	Warrenton	October
	MO 6010834	Warrenton	December
Washington	MO 4010003	Caledonia	September
	MO 4040818	Cabreva Acres	March
	MO 4040818	Cabreva Acres	April
	MO 4040818	Cabreva Acres	May
	MO 4201034	Fourche Valley Golf Club	October
	MO 4212819	Ozark Freeze Restaurant	February
	MO 4292853	Roy's Family Market	August
	MO 4292853	Roy's Family Market	October
	MO 6010659	Potosi	May
	MO 6010659	Potosi	July
	MO 6024633	Washington Co PWSD #1	July
	MO 6024633	Washington Co PWSD #1	November
	MO 6120173	Washington State Park	November
Webster	MO 5010218	Diggins	May
	MO 5010503	Marshfield	October
	MO 5048282	Gaslight Village MHP	November
	MO 5069035	Ozark Correctional Center	September
	MO 5182899	Sho Me Power Electric Coop	October

## II. Chemical MCL Violations

County	Id#	System Name	Chemical
Bates	MO 1024031	Bates Co PWSD #2	Total Trihalomethanes (TTHM)
	MO 1024031	Bates Co PWSD #2	Total Haloacetic Acids (HAA5)
Boone	MO 3010181	Columbia	Total Trihalomethanes (TTHM)
Caldwell	MO 1010099	Breckenridge	Total Haloacetic Acids (HAA5)
	MO 1010342	Hamilton	Total Haloacetic Acids (HAA5)
	MO 1010342	Hamilton	Total Trihalomethanes (TTHM)
Cass	MO 1010301	Garden City	Total Haloacetic Acids (HAA5)
Clark	MO 2010875	Wyaconda	Total Haloacetic Acids (HAA5)
	MO 2010875	Wyaconda	Total Trihalomethanes (TTHM)
Daviess	MO 1036130	Daviess Co PWSD #3	Total Trihalomethanes (TTHM)
DeKalb	MO 1010510	Maysville	Total Haloacetic Acids (HAA5)
	MO 1010510	Maysville	Total Trihalomethanes (TTHM)
Grundy	MO 2010796	Trenton Municipal Utilities	Total Trihalomethanes (TTHM)
Harrison	MO 1024242	Harrison Co PWSD #2	Total Trihalomethanes (TTHM)
Lincoln	MO 6024340	Lincoln Co PWSD #1	Fluoride
	MO 6031217	Timber Ridge Estates	Fluoride
Linn	MO 2010112	Bucklin	Total Haloacetic Acids (HAA5)
	MO 2010497	Marceline	Total Haloacetic Acids (HAA5)
	MO 2010497	Marceline	Total Trihalomethanes (TTHM)
Moniteau	MO 3171198	High Point Elementary School	Benzene
Monroe	MO 2010538	Monroe City	Total Haloacetic Acids (HAA5)
Montgomery	MO 6010848	Wellsville	Total Haloacetic Acids (HAA5)
	MO 6010848	Wellsville	Total Trihalomethanes (TTHM)
Newton	MO 5041190	Raines MHP	Total Haloacetic Acids (HAA5)
Randolph	MO 2010533	Moberly	Total Haloacetic Acids (HAA5)
	MO 2182290	Assoc Electric Thomas Hill 3	Total Haloacetic Acids (HAA5)
Saline	MO 2010745	Slater	Total Trihalomethanes (TTHM)

### III. Radiological MCL

County	ID#	System Name	Chemical
Callaway	MO 3048994	New Christian Life Fellowship	Radium, Combined (226, 228)
Cape	MO 4031453	Westlake Meadows Subdivision	Gross Alpha, Inclng RA, Exclng RN & U
	MO 4031453	Westlake Meadows Subdivision	Radium, Combined (226, 228)
Iron	MO 4036256	Killarney Shores Subd	Radium, Combined (226, 228)
	MO 4069040	Bellevue Valley Nursing Home	Radium, Combined (226, 228)
Lincoln	MO 6024340	Lincoln Co PWSD #1	Gross Alpha, Inclng RA, Exclng RN & U
	MO 6024340	Lincoln Co PWSD #1	Radium, Combined (226, 228)
	MO 6041229	Autumn Hills MHP	Gross Alpha, Inclng RA, Exclng RN & U
	MO 6041229	Autumn Hills MHP	Radium, Combined (226, 228)
McDonald	MO 5010449	Lanagan	Radium, Combined (226, 228)
	MO 5010645	Pineville	Gross Alpha, Inclng RA, Exclng RN & U
	MO 5010645	Pineville	Radium, Combined (226, 228)
	MO 5021168	McDonald Co PWSD #3	Gross Alpha, Inclng RA, Exclng RN & U
	MO 5021168	McDonald Co PWSD #3	Radium, Combined (226, 228)
Montgomery	MO 6010521	Middletown	Radium, Combined (226, 228)
	MO 6010521	Middletown	Gross Alpha, Inclng RA, Exclng RN & U
St Francois	MO 4010087	Bonne Terre	Gross Alpha, Inclng RA, Exclng RN & U
	MO 4010087	Bonne Terre	Radium, Combined (226, 228)
	MO 4010270	Farmington	Radium, Combined (226, 228)
	MO 4010270	Farmington	Gross Alpha, Inclng RA, Exclng RN & U
	MO 4010279	Park Hills	Gross Alpha, Inclng RA, Exclng RN & U
	MO 4010279	Park Hills	Radium, Combined (226, 228)
	MO 4031206	Hunters Ridge Subd	Radium, Combined (226, 228)
	MO 4031206	Hunters Ridge Subd	Gross Alpha, Inclng RA, Exclng RN & U
	MO 4036059	Terre Du Lac	Gross Alpha, Inclng RA, Exclng RN & U
	MO 4036059	Terre Du Lac	Radium, Combined (226, 228)
	MO 4041308	Walnut Grove MHP	Gross Alpha, Inclng RA, Exclng RN & U
	MO 4041308	Walnut Grove MHP	Radium, Combined (226, 228)
	MO 4069041	Farmington Correctional Center	Gross Alpha, Inclng RA, Exclng RN & U
	MO 4069041	Farmington Correctional Center	Radium, Combined (226, 228)
St Louis	MO 6069015	Whispering Oaks Health Care	Radium, Combined (226, 228)
Vernon	MO 5010104	Bronaugh	Radium, Combined (226, 228)
	MO 5010104	Bronaugh	Gross Alpha, Inclng RA, Exclng RN & U
	MO 5024616	Vernon Co PWSD #1	Gross Alpha, Inclng RA, Exclng RN & U
	MO 5024616	Vernon Co PWSD #1	Radium, Combined (226, 228)
Washington	MO 4011123	Mineral Point	Radium, Combined (226, 228)
	MO 4011123	Mineral Point	Gross Alpha, Inclng RA, Exclng RN & U
	MO 6010659	Potosi	Gross Alpha, Inclng RA, Exclng RN & U
	MO 6010659	Potosi	Radium, Combined (226, 228)

#### IV. Surface Water

The Following Systems Violated The Surface Water Rule, Treatment Technique For Turbidity Or Other Surface Water Requirements In The Months Or Annual Period Indicated

County	Id#	System Name	Period	Violation
Barton	MO 5010446	Lamar	July	Combined Filter Effluent Turbidity
Bates	MO 1010001	Adrian	November	Combined Filter Effluent Turbidity
	MO 1010001	Adrian	April	Combined Filter Effluent Turbidity
Caldwell	MO 1010099	Breckenridge	3 <sup>rd</sup> Quarter	Inadequate DBP Precursor Removal
	MO 1010099	Breckenridge	June	Combined Filter Effluent Turbidity
Cass	MO 1010225	Drexel	September	Combined Filter Effluent Turbidity
Clark	MO 2010875	Wyaconda	November	Combined Filter Effluent Turbidity
	MO 2010875	Wyaconda	December	Combined Filter Effluent Turbidity
	MO 2010875	Wyaconda	October	Combined Filter Effluent Turbidity
	MO 2010875	Wyaconda	August	Combined Filter Effluent Turbidity
	MO 2010875	Wyaconda	September	Combined Filter Effluent Turbidity
	MO 2010875	Wyaconda	1 <sup>st</sup> Quarter	Inadequate DBP Precursor Removal
Dekalb	MO 1010510	Maysville	March	Combined Filter Effluent Turbidity
Jasper	MO 5010413	Mo American Joplin	January	Combined Filter Effluent Turbidity
Jefferson	MO 6182217	Ameren U E Rush Island	February	Combined Filter Effluent Turbidity
Linn	MO 2010497	Marceline	1 <sup>st</sup> Quarter	Inadequate DBP Precursor Removal
Montgomery	MO 6010848	Wellsville	1 <sup>st</sup> Quarter	Inadequate DBP Precursor Removal
	MO 6010848	Wellsville	2 <sup>nd</sup> Quarter	Inadequate DBP Precursor Removal
	MO 6010848	Wellsville	3 <sup>rd</sup> Quarter	Inadequate DBP Precursor Removal
	MO 6010848	Wellsville	4 <sup>th</sup> Quarter	Inadequate DBP Precursor Removal
Nodaway	MO 1010508	Maryville	1 <sup>st</sup> Quarter	Inadequate DBP Precursor Removal
	MO 1010508	Maryville	2 <sup>nd</sup> Quarter	Inadequate DBP Precursor Removal
	MO 1010508	Maryville	3 <sup>rd</sup> Quarter	Inadequate DBP Precursor Removal
	MO 1010508	Maryville	4 <sup>th</sup> Quarter	Inadequate DBP Precursor Removal
St Francois	MO 4240120	S F Scout Ranch	January	Combined Filter Effluent Turbidity

## Appendix B

### Chronic Major Monitoring

The following systems had three or more major violations of the Total Coliform Rule in 2008 and have been listed on previously issued news releases for chronic monitoring violations.

County	System Name	PWS ID #	Months
Barry	The Playce	MO 5191334	March, September, October, November
Benton	Grand River Resort	MO 3190267	March, April, October
	Hidden Valley Mobile Home Park	MO 3262156	May, November, December
	Sun Valley Subdivision	MO 3031366	January, February, March, April, May, June, July, August, September, October, November, December
Camden	Deepwater Inn	MO 3198084	February, March, June, August
	Dempseys Restaurant	MO 5212746	May, June, September
	Kelleys Landing	MO 3190038	March, May, June, September
	Palisades Condo Owners Ass.	MO 3200834	February, May, June, August
	Possum Holler	MO 3212540	April, May, June
	Shrimp Daddys	MO 3212447	August, September, October, November, December
	The Flame Resort	MO 3190735	March, April, May, June
Carter	Piney Wood	MO 4218536	April, September, November
Dallas	Ho Humm Campground	MO 5240083	May, June, July, August
	Menagerie Campground	MO 5242816	March, April, May, June, July, October
Dent	Teris Country Homes	MO 4048230	February, March, May
Franklin	Charmwood Subdivision	MO 6030106	February, March, April, May, July, August, September, October, November, December
	Delta Motel	MO 6191037	January, February, March, April, May
Gasconade	Silver Dollar Lounge	MO 6211503	July, September, November
Greene	American Legion Post #676	MO 5218149	June, July, November
Jasper	Double Diamond Fuel Mart	MO 5211363	January, June, August
	Downhome Bar & Grill	MO 5212510	January, February, August
	Royal Oaks Arena	MO 5218143	March, May, October, November, December
Jefferson	Lake Forest Properties	MO 6030365	July, October, November, December
Lafayette	Wellington	MO 1010846	March, May, November, December
Lawrence	Baumers Food Mart	MO 5292361	May, June, July, September, December
Miller	Construction Site Bar & Grill	MO 5212698	February, May, November, December
	Sunset Mobile Home Park	MO 5031430	February, March, June, September, October, November
Mississippi	Merryweather Meadows	MO 4048066	May, July, August,
Morgan	Downtown Diner	MO 3211428	September, October, December
	The Dummy Restaurant And Bar	MO 3218211	April, May, September
	Three Pigs Bar B Q And Grill	MO 3212457	March, April, May, June, August, September, October, November, December
	Three Pigs BBQ And Marina	MO 3212568	July, August, September
	Time Out Sports Bar And Grill	MO 3210066	July, August, September
Nodaway	Clearmont	MO 1010173	May, July, August
Ozark	Rusty Rail Pub	MO 5212897	May, June, July, August, September, October, November, December
Pettis	North 65 Cafe	MO 3218262	April, May, August
	Stone Creek Development	MO 1282687	June, July, August, September, October, November, December
Polk	Cases Corner LLC	MO 5258125	September, October, November, December
	Time Out Club & Grill	MO 5281525	January, February, March, April, May, June, July, August, September, October, November, December
Scott	Haywood City	MO 4010971	January, February, April
St Clair	Old Plantation Motel	MO 5212121	February, March, April, May, June, July, September
St Francois	Sherrys	MO 4292597	March, May, October

<b>County</b>	<b>System Name</b>	<b>PWS ID #</b>	<b>Months</b>
Stone	Bridgeport 1 <sup>st</sup> Addition	MO 5031420	June, July, September
	Cross Roads Store	MO 5292589	April, August, September, December
	Holiday Hills 1 2 3 Addition	MO 5036017	June, October, November
	Starlight Village	MO 5030473	January, February, March, April, May, June, July, August, September, October, November, December
	Starrlite Village 4 <sup>th</sup> Addition	MO 5258070	January, February, March, April, May, July, August, September, October, November, December
Taney	Bradleyville R I School	MO 5171231	May, October, December
	Tablerock Inn	MO 5211609	January, March, November, December

## Appendix C

### Major Repeat Monitoring Violations

The following systems had major repeat monitoring violations for the months listed. A major repeat monitoring violation occurs when a routine sample tests positive for total coliform bacteria and that system fails to submit any follow-up, or repeat, samples as required.

<b>County</b>	<b>ID#</b>	<b>System Name</b>	<b>Month(s)</b>
Barry	MO 5211485	Timberoc Village Shopping Center	November
	MO 5252497	Eagle Point Property Owners Association	October
	MO 5282780	His Childrens Camp	August
Benton	MO 3036072	Lakeview Heights Subd	October
Camden	MO 3238097	The Falls Condominiums	July
	MO 5212764	Its Twelve O'Clock Somewhere	July
	MO 5212796	Bear Bottom Resort	July
Douglas	MO 5241141	Twin Bridges Canoe & Campground	September
	MO 5282625	C L Discount Grocery	August
Franklin	MO 6031090	Laura Meadows Apartments	July
Gasconade	MO 3272482	Shepherd of the Hills Lutheran Church	August
Greene	MO 5048107	Country Squire Village	November
	MO 5210110	Springfield Skateland	June
	MO 5292838	Compass Plaza	March
Hickory	MO 5261466	Hickory Hollow MHP	December
Jefferson	MO 6036081	Meadow Drive Subd	March
	MO 6048142	D & J MHP	August
Lawrence	MO 5041314	Youngberg Estates MHP	August
Maries	MO 3210835	Vichy Wye Restaurant	November
Morgan	MO 3212560	Uncle Sams Ice Cream & Deli	June
	MO 5212905	Vinnys Cafe And Lounge	September
Nodaway	MO 1010173	Clearmont	June
Ray	MO 1010346	Hardin	August
Stone	MO 5031446	Stone Co Country Meadows HOA Inc	June
	MO 5036017	Holiday Hills 1 2 3 Addition	April
	MO 5036017	Holiday Hills 1 2 3 Addition	May
	MO 5258136	Pizza World	July
Taney	MO 5031241	Bear Creek Water & Sewer	August



## Appendix D

### Significant Non-Compliers

The following systems had been deemed Significant Non-Compliers for 2008. These are the systems with serious violations that potentially affect public health or with multiple monitoring violations.

County	PWS ID #	Name	Rule
Barry	MO 5031084	Roaring River Homeowners Assn. Inc.	Total Coliform Rule
Barry	MO 5036300	Oaks Homeowners Assn. Water District	Consumer Confidence Report
Bates	MO 1024031	Bates County PWS #2	HAA5
Bates	MO 1024031	Bates County PWS #2	TTHM
Benton	MO 1212779	Valley Bar and Grill	Total Coliform Rule
Benton	MO 3031366	Sun Valley Subdivision	Consumer Confidence Report
Benton	MO 3031366	Sun Valley Subdivision	Total Coliform Rule
Benton	MO 3040761	Lake Hills Mobile Home/RV Park	Consumer Confidence Report
Benton	MO 3201440	The Old Oar House Inn	Total Coliform Rule
Benton	MO 3262156	Hidden Valley Mobile Home Park	Consumer Confidence Report
Boone	MO 3010181	Columbia	TTHM
Butler	MO 4040680	Whites Trailer Court	Consumer Confidence Report
Caldwell	MO 1010342	Hamilton	HAA5
Caldwell	MO 1010342	Hamilton	TTHM
Camden	MO 3031133	Arrow Ridge Shores	Consumer Confidence Report
Camden	MO 3031333	Big Bear Estates	Total Coliform Rule
Camden	MO 3048141	Southway Terrace Mobile Home Park	Consumer Confidence Report
Camden	MO 3191837	Hawks Nest Condo Association	Lead & Copper
Camden	MO 3218004	Paradise Rest	Nitrates
Camden	MO 3238092	Osage Heritage Condominiums	Total Coliform Rule
Camden	MO 5212764	Its Twelve O'clock Somewhere	Total Coliform Rule
Cape Girardeau	MO 4079503	Mid America Teen Challenge	Consumer Confidence Report
Carter	MO 4010811	Van Buren	Lead & Copper
Cedar	MO 5010411	Jerico Springs	Consumer Confidence Report
Christian	MO 5031315	James River Estates Subdivision	Consumer Confidence Report
Christian	MO 5031578	McGinnis Estates Subdivision	Lead & Copper
Christian	MO 5031578	McGinnis Estates Subdivision	Total Coliform Rule
Christian	MO 5039093	Country Meadows Estates	Consumer Confidence Report
Christian	MO 5040176	Midland Water Co.	Consumer Confidence Report
Clark	MO 2010874	Wyaconda	HAA5
Clark	MO 2010874	Wyaconda	SWTR
Clark	MO 2010874	Wyaconda	TTHM
Clay	MO 1010546	Mosby	Consumer Confidence Report
Cole	MO 3010257	Eugene	Consumer Confidence Report
Dade	MO 5010025	Arcola	Consumer Confidence Report
Dade	MO 5010749	South Greenfield	Consumer Confidence Report
Dallas	MO 5218054	Fraternal Order of Eagles	Nitrates
Dallas	MO 5242816	Menagerie Campground	Total Coliform Rule
Daviess	MO 1010405	Jameson	Consumer Confidence Report
Dekalb	MO 1010510	Maysville	HAA5
Dekalb	MO 1010510	Maysville	TTHM
Dekalb	MO 1010609	Osborn	Consumer Confidence Report
Franklin	MO 6030106	Charmwood Subdivision	Consumer Confidence Report
Franklin	MO 6030106	Charmwood Subdivision	Total Coliform Rule
Franklin	MO 6036009	Franklin County Water Co. Inc.	Consumer Confidence Report
Franklin	MO 6036269	Woodland Hills Subdivision	Consumer Confidence Report
Franklin	MO 6242645	Camp Trinity	Total Coliform Rule

<b>County</b>	<b>PWSID</b>	<b>Name</b>	<b>Rule</b>
Gasconade	MO 3031317	Lake Northwoods Utility Incorporated	Consumer Confidence Report
Greene	MO 5031325	Golden Oak Village Subdivision	Lead & Copper
Greene	MO 5048075	Whispering Lane Mobile Home Park	Consumer Confidence Report
Greene	MO 5048165	Timbercrest Mobile Home Park	Consumer Confidence Report
Greene	MO 5048194	Oak Crest Estates Mobile Home Subdivision	Consumer Confidence Report
Greene	MO 5069088	General Council Assemblies Of God	Consumer Confidence Report
Greene	MO 5182849	JM & M Investments	Lead and Copper
Greene	MO 5292347	Jump Stop #309	Total Coliform Rule
Greene	MO 5292838	Compass Plaza	Total Coliform Rule
Howell	MO 4024264	Howell County PWSD #1	Consumer Confidence Report
Jasper	MO 5010141	Carterville	Consumer Confidence Report
Jasper	MO 5048021	Sunset Mobile Home Park	Consumer Confidence Report
Jasper	MO 5218143	Royal Oaks Arena	Total Coliform Rule
Jefferson	MO 6030365	Lake Forest Properties	Consumer Confidence Report
Jefferson	MO 6031110	Briarwood Utilities	Consumer Confidence Report
Jefferson	MO 6048048	Country Aire Estates	Lead and Copper
Johnson	MO 262830	Pembroke Park	Lead and Copper
Laclede	MO 5192285	Munger Moss Motel	Consumer Confidence Report
Lawrence	MO 5041314	Youngberg Estates Mobile Home Park	Total Coliform Rule
Lawrence	MO 5272726	Freedom Christian Center	Lead and Copper
Lawrence	MO 5292360	Stop & Shop	Total Coliform Rule
Lincoln	MO 6031357	Fawn Lakes	Consumer Confidence Report
Lincoln	MO 6036217	Lakeview Subd Water System	Consumer Confidence Report
Lincoln	MO 6041229	Autumn Hills Mobile Home Park	Gross Alpha
Lincoln	MO 6041229	Autumn Hills Mobile Home Park	Radium
Lincoln	MO 6272640	Family Child Care Center	Lead and Copper
Linn	MO 2010112	Bucklin	HAA5
Linn	MO 2010497	Marceline	HAA5
McDonald	MO 5021168	Mc Donald County PWSD #3	Radium
McDonald	MO 5041094	Elk O Vue River Park Mobile Home Park	Consumer Confidence Report
Miller	MO 3048243	Eagle Mobile Home Park	Lead and Copper
Miller	MO 5031430	Sunset Mobile Home Park	Consumer Confidence Report
Miller	MO 5031430	Sunset Mobile Home Park	Total Coliform Rule
Mississippi	MO 4048066	Merryweather Meadows	Consumer Confidence Report
Moniteau	MO 3024395	Moniteau County PWSD #1	Consumer Confidence Report
Montgomery	MO 3281053	Loutre Shore Country Club	Total Coliform Rule
Montgomery	MO 6010848	Wellsville	HAA5
Montgomery	MO 6010848	Wellsville	TOC Removal
Montgomery	MO 6010848	Wellsville	TTHM
Morgan	MO 3010047	Barnett	Consumer Confidence Report
Morgan	MO 3031227	Sheldon Point HOA	Lead & Copper
Morgan	MO 3212457	Three Pigs Bar B Q and Grill	Total Coliform Rule
New Madrid	MO 4024416	New Madrid County PWSD #2	Consumer Confidence Report
New Madrid	MO 4024418	New Madrid County PWSD #4	Consumer Confidence Report
Newton	MO 5041190	Raines Mobile Home Park	HAA5
Newton	MO 5212860	The Jungle	Total Coliform Rule
Nodaway	MO 1010249	Elmo	Consumer Confidence Report
Nodaway	MO 1010508	Maryville	TOC Removal
Osage	MO 3024439	Osage County PWSD #3	Total Coliform Rule
Ozark	MO 5030209	Sundown Village Of	Consumer Confidence Report
Ozark	MO 212897	Rusty Rail Pub	Total Coliform Rule
Pemiscot	MO 4010959	Hayti Heights	Consumer Confidence Report
Pettis	MO 1272873	Camp Branch Baptist Church	Total Coliform Rule

<b>County</b>	<b>PWSID</b>	<b>Name</b>	<b>Rule</b>
Pettis	MO 1282687	Stone Creek Development	Consumer Confidence Report
Pettis	MO 1282687	Stone Creek Development	Lead & Copper
Pettis	MO 1282687	Stone Creek Development	Total Coliform Rule
Pettis	MO 3036179	Southgate Subdivision	Consumer Confidence Report
Pettis	MO 3048254	Crestview Mobile Home Park	Consumer Confidence Report
Phelps	MO 3036151	Gladlo Water & Sewer Inc.	Consumer ConfidEnce Report
Phelps	MO 3048124	Tanglewood Mobile Court	Consumer Confidence Report
Polk	MO 5281525	Time Out Club & Grill	Total Coliform Rule
Randolph	MO 2010533	Moberly	HAA5
Saline	MO 2010305	Gilliam	Consumer Confidence Report
Saline	MO 2024555	Saline County PWSID #1	Consumer Confidence Report
Scott	MO 4010971	Haywood City	Total Coliform Rule
St Charles	MO 6010919	Weldon Spring Heights Village	Total Coliform Rule
St Clair	MO 5212121	Old Plantation Motel	Total Coliform Rule
St Francois	MO 4010270	Farmington	Gross Alpha
St Francois	MO 4010270	Farmington	Radium
St Francois	MO 4010279	Park Hills	Radium
St Francois	MO 4021451	Pilot Knob Rural WD #1 Doe Run Area	Lead & Copper
St Francois	MO 4031206	Hunters Ridge Subdivision	Radium
St Francois	MO 4036059	Terre Du Lac	Consumer Confidence Report
St Francois	MO 4036059	Terre Du Lac	Radium
St Francois	MO 4041308	Walnut Grove Mobile Home Park	Radium
St Francois	MO 4069041	Farmington Correctional Center	Radium
St Francois	MO 4069082	L & J Boarding Home	Consumer Confidence Report
Stone	MO 5030473	Starlight Village	Consumer Confidence Report
Stone	MO 5030473	Starlight Village	Nitrates
Stone	MO 5030473	Starlight Village	Total Coliform Rule
Stone	MO 5031128	Blue Water Village/Blakewood Subdivision	Consumer Confidence Report
Stone	MO 5031343	Cape Fair Estates	Consumer Confidence Report
Stone	MO 5031353	Forest Glen/Quail Ridge Subdivision	Consumer Confidence Report
Stone	MO 5031446	Stone Co Country Meadows HOA, Inc.	Total Coliform Rule
Stone	MO 5036090	Village Of Coney Island	Consumer Confidence Report
Stone	MO 5036315	Riverfork Ranch Estates	Consumer Confidence Report
Stone	MO 5040355	Rocky Top Mobile Home Court	Consumer Confidence Report
Stone	MO 5258070	Starrlite Village 4th Addition	Consumer Confidence Report
Stone	MO 5258070	Starrlite Village 4th Addition	Lead & Copper
Stone	MO 5258070	Starrlite Village 4th Addition	Total Coliform Rule
Stone	MO 5258136	Pizza World	Nitrates
Stone	MO 5282522	Summer Fresh Supermarket	Lead & Copper
Taney	MO 5030690	Highlands Sewer & Water Association, Inc.	Consumer Confidence Report
Taney	MO 5036268	Lakeview Subdivision, Block C	Consumer Confidence Report
Taney	MO 5071460	Oakview Apartments	Consumer Confidence Report
Taney	MO 5171231	Bradleyville R-I School	Total Coliform Rule
Taney	MO 5191988	Rustic Acres	Total Coliform Rule
Taney	MO 5282768	Oakmont Hills	Nitrates
Texas	MO 4048167	Country Aire Mobile Home Park	Consumer Confidence Report
Washington	MO 4011123	Mineral Point	Radium
Washington	MO 4040230	Harper Valley Trailer Park	Consumer Confidence Report
Washington	MO 4041275	L & M Mobile Home Park	Consumer Confidence Report
Washington	MO 6010659	Potosi	Radium
Webster	MO 5048281	Fountain Plaza Mobile Home Park	Consumer Confidence Report
Wright	MO 5048231	Shady Oak Mobile Home Park	Consumer Confidence Report
Wright	MO 5069037	Rocky Ridge Manor	Consumer Confidence Report